

January 11, 2018



The Mayor and Members of Council
City of Elliot Lake
Municipal Office
45 Hillside Drive North
Elliot Lake, Ontario P5A 1X5

ATTENTION: Mayor and Member of Council

**RE: ELLIOT LAKE WATER TREATMENT PLANT SUMMARY REPORT FOR
MUNICIPALITIES: Municipal Large Residential**

Your Worship Mayor Marchisella and Members of Council:

Please find attached, the 2017 Summary Report for the Elliot Lake Water Treatment Plant. This report has been prepared in accordance to the guidelines set out in Schedule 22 of the Safe Drinking Water Act, 2002 (Ontario Regulation 170/03).

The report covers the period from January 1, 2017 to December 31, 2017.

Please direct any questions or concerns to the undersigned.

Yours truly,

A handwritten signature in black ink that reads "Daryl Halloch". The signature is written in a cursive style with a large initial "D".

Daryl Halloch
Manager of Environmental Services

Elliot Lake Water Treatment Plant 2017 Summary Report

The purpose of this report is to summarize water quality and quantity data pertaining to the Elliot Lake water treatment plant.

This report is prepared in accordance with Schedule 22 of Regulation 170/03 of Ontario's Safe Drinking Water Act and covers the reporting period from January 1, 2017 to December 31, 2017.

The report contains the following information:

- A summary of the quantities and flow rates of the water supplied including monthly average and maximum daily flows.
- A comparison of the peak flows and capacities to the rated capacities referenced in the drinking water works permit and municipal drinking water licence.
- A listing of all requirements of the Act, the Regulations, the systems Drinking Water Permit and Licence, and applicable system approvals that the system failed to meet during the period covered by the report. This includes any measures taken to mitigate the failure and the duration of the incident.
- Terms and conditions identified in the Act, relevant regulations, drinking water permit, and municipal drinking water licence.

Under the Regulation, this report must be provided to Members of Municipal Council not later than March 31st of each calendar year.


Upon approval of Council, the report is posted on the City of Elliot Lake website and can be found at the following link: <http://www.cityofelliotlake.com/en/cityhall/operationsreports.asp>

Annual Quantities and Flow Rates:

MONTH	Minimum Flow / Day (M ³)	Maximum Flow / Day (M ³)	Average Flow / Day (M ³)	Instantaneous Peak flow (l/s)	Total Flow (M ³)
January	3,678	7,967	5,170	174.35	168,869
February	3,290	6,854	5,150	121.76	151,786
March	3,702	6,890	5,154	168.70	168,173
April	3,550	6,381	4,979	165.29	157,144
May	3,788	7,164	5,054	166.30	164,867
June	3,903	7,267	5,546	175.47	166,658
July	4,377	7,881	5,864	239.47	190,935
August	3,627	7,175	5,198	106.76	166,365
September	3,617	6,781	5,126	106.25	161,069
October	3,079	8,169	5,176	164.16	168,804
November	3,906	6,767	5,460	163.63	172,748
December	4,514	7,993	6,135	172.90	199,274
Minimum	3,079	6,381	4,979	106.25	151,786
Maximum	4,514	8,169	6,135	239.47	199,274
Average	3,753	7,274	5,334	160.42	169,724
Total Flow for 2016					2,036,692

As noted in the graph below, the maximum rated capacity of **28,400 m³/day** (as identified in the facility's Municipal Drinking Water Licence) was not exceeded for the period of this report.

Comparison of Maximum Daily Flow to Rated Capacity 2017

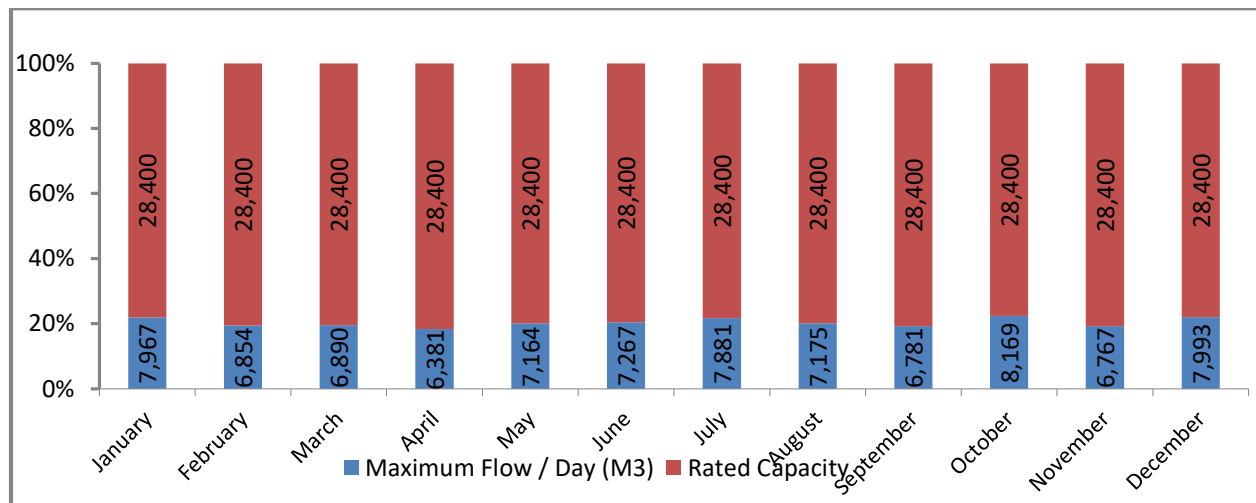

Regulatory Inspection

The Ministry of the Environment carried out a facility inspection on August 30th, 2017. No orders were issued and no additional action has been required to date.

Compliance Report

Section 18 of the Safe Drinking Water Act requires the system operator to report adverse test results or conditions immediately after the result is obtained or situation identified.

A test result is considered adverse when the sample being tested fails to meet the prescribed drinking water standards. Limits for all parameters being tested under the Acts and Regulations are identified under the various Regulations associated with the Safe Drinking Water Act, 2002.

Adverse test results must be identified in the Summary Report.

Situations involving the depressurization of any portion of the distribution system for repair of a watermain can be deemed as an adverse event due to the potential for contamination through back siphonage or pressurized backflow. These incidents are included in the list of adverse events. They are indicated as evidence of best practice on the part of the Public Works Department.

There were 6 instances in 2017 where reports were made to the Health Unit and Spills Action Centre in accordance with Section 18 of the Safe Drinking Water Act.

Corrective Action:

In all cases when repair or maintenance carried out on the distribution system requires complete depressurization of any part of the system, the Algoma Health Unit is notified. This scenario is considered to be a “failure of mechanical containment”, which can potentially lead to contamination through back siphonage or pressurized backflow.

These situations are treated as an adverse incident by the Algoma Health Unit, and either a Boil Water Advisory or Drinking Water Advisory is issued in order to protect the consumer from potential risk. Boil Water Advisories are issued when the risk to the system is deemed to be bacteriological in nature, whereas a Drinking Water Advisory is issued in situations where the Health Unit is concerned with physical, chemical, or organic contamination.

Following the repair, flushing is undertaken to restore quality. Once completed, two consecutive sets of bacteriological tests are taken, at 24 hour intervals, after which, if all is clear, the advisory is lifted.

In situations where bacteriological counts are detected during sampling, the Algoma Health Unit and Spills Action Center are notified. Typically, a boil water advisory is issued and remains in place until two consecutive sets of bacteriological tests are taken, at 24 hour intervals, after which, if all is clear, the advisory is lifted.

Adverse Water Quality Incidents:

Incident Date	Parameter	Results	Unit of Measure	Corrective Action	Corrective Action Date
Jan-27-17	Water Main Repair	Pressure Loss	PSI	Boil water Advisory Flush and sample	Feb-6-17
Mar-09-17	Sample result – Microbiological	40 Total Coliforms	PSI	Boil water Advisory Flush and sample	Mar-14-17
Apr-26-17	Sample result – Microbiological	1 Total Coliform	PSI	Boil Water Advisory Flush and Sample	May-1-17
June-22-17	Sample result – Microbiological	1 Total Coliform	PSI	Boil Water Advisory Flush and Sample	June-27-17
Sept-27-17	Sample result - Microbiological	15 Total Coliforms	CFU/100 ml	Boil Water Advisory Flush and Sample	Oct-03-17
Sept-29-17	Sample result – Microbiological	54 Total Coliforms	PSI	Boil Water Advisory Flush and Sample	Oct-05-17

Identified Terms and Conditions

Performance:

The Elliot Lake Water Treatment Plant meets the requirement of the Ontario “Drinking Water Standards.” Disinfection of treated water is achieved as per Ministry Procedure B13-3. Required CT was continuously monitored and met at all times ensuring appropriate levels of disinfection were attained.

Backwash water discharge suspended solids were monitored with an average of **16.4 mg/l** which is below the required **25 mg/l** annual average.

Monitoring and Recording:

Flow meters, chlorine analyzers and turbidimeters are calibrated per manufacturer’s specifications. Third party certification is secured on an annual basis as a quality assurance, quality control measure.

Operations and Maintenance:

Maintenance of the water treatment plant is conducted, monitored, documented, and controlled through a preventive maintenance program. All operators are certified with at least one operator certified at the designated level of the facility. All treatment chemicals meet A.W.W.A. (American Water Works Association) and ANSI / NSF 60 quality criteria for drinking water.

Process Parameters:

The following are the chemicals used and dosage rates:

- PolyaluminumChloride - 25.21 mg/l
- Hydrofluorosilicic Acid – 2.22 mg/l
- Chlorine – 2.53 mg/l
- Hydrated Lime – 6.18 mg/l

Drinking Water Quality Management System

The Quality Management System (QMS) consists of an Operational Plan that defines and documents the various policies and procedures with respect to water quality management which were established to meet the Province of Ontario standards as identified within the Safe Drinking Water Act.

The Internal and Managerial Reviews along with a Surveillance Audit were all completed in 2017 per the requirements outlined in the Operational Plan found in the Drinking Water Quality Management System.

Documentation:

Contingency plans, the Facility Operations Manual, Standard Operating Procedures and the Drinking Water Quality Management Standard documents which provide guidance in the event of emergencies, upset conditions and breakdowns are located in the office at the water treatment facility. Detailed drawings of the facility are centrally located in the Operational Control Room.